


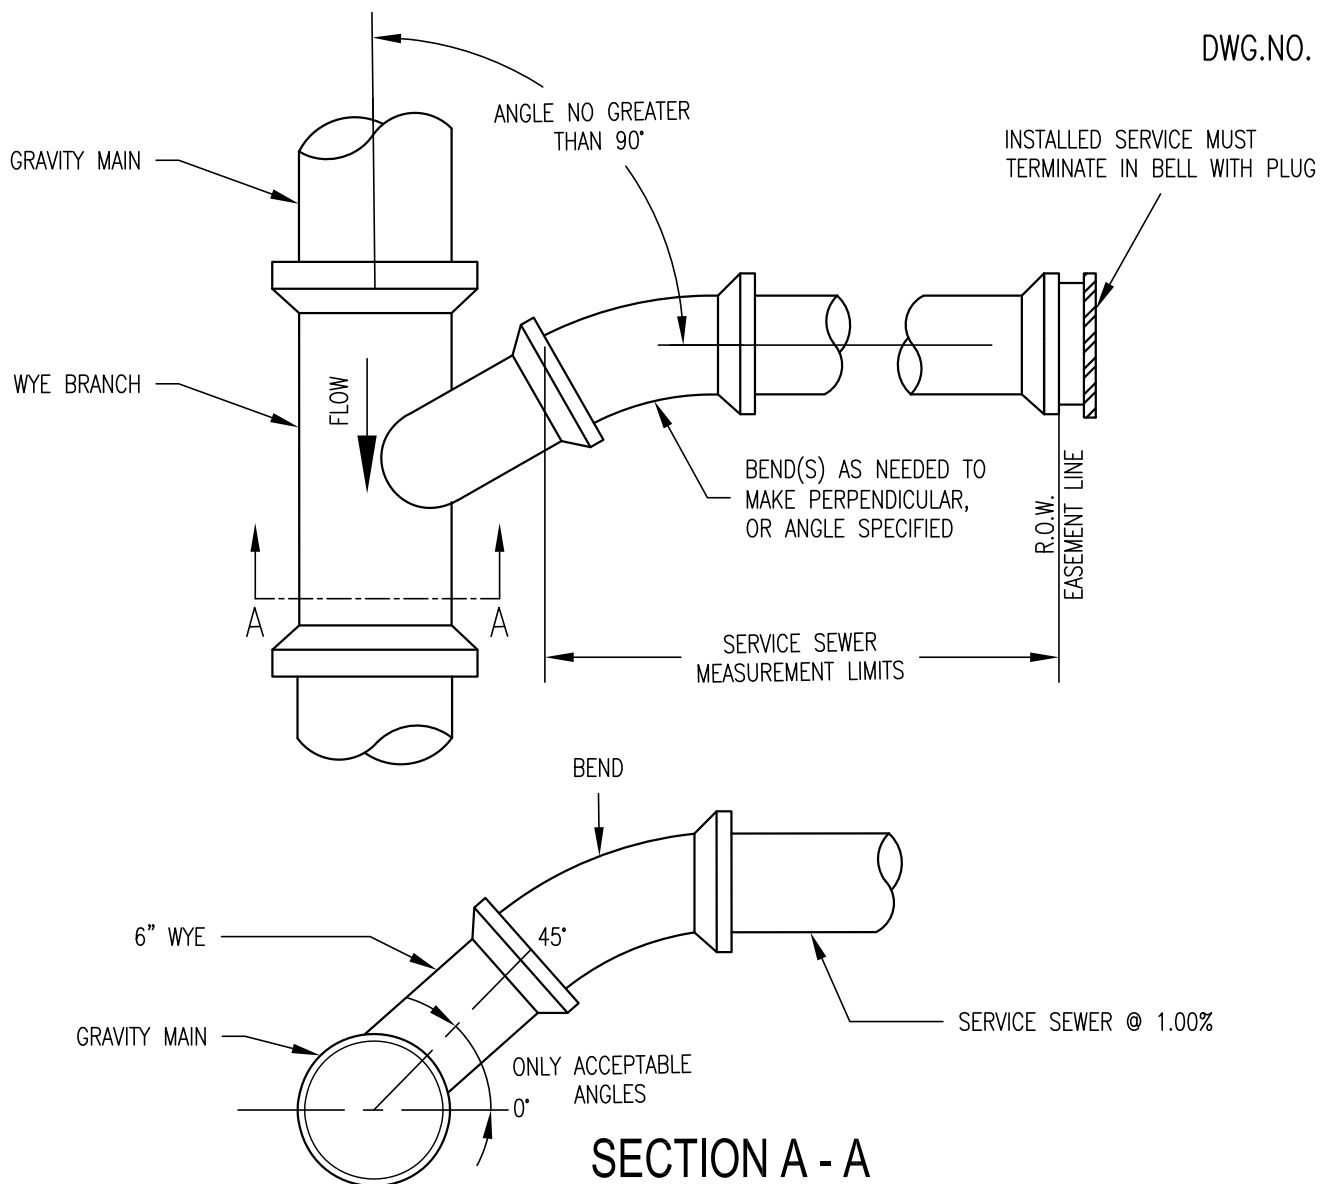

NOTES:

- 1) SERVICE SEWER TO BE LAID ON CONTINUOUS SLOPE. MIN, 1.00% GRADE.
- 2) WYE ANGLES TURNED GREATER THAN 45° AS SHOWN, WILL REQUIRE A STACK. SEE DWG 7 FOR STACK ON 8"-12" MAINLINE & 7A FOR 15" & LARGER MAINLINE
- 3) SERVICE SEWER WILL BE 6" DIAMETER UNLESS OTHERWISE STATED, PAYMENT & MEASUREMENT IS BASED ON SHORT & LONG SIDES OF THE R/W. BORING UNDER PAVEMENTS MAY BE REQUIRED BY ENGINEER.
- 4) NO CLEANOUTS WILL BE ALLOWED WITHIN ROW OR EASEMENT UNLESS OTHERWISE STATED OR APPROVED BY ENGINEER.
- 5) SEE DWG 1 OR DWG 2 FOR BEDDING & TRENCH REQUIREMENTS.

NO SCALE

APPROVED 03/18

REVISION	DATE	BY

STARK COUNTY
SANITARY ENGINEERING DEPT.

DETAIL DWG.NO. 6

ITEM NO. N/A

STANDARD SERVICE
CONNECTION