


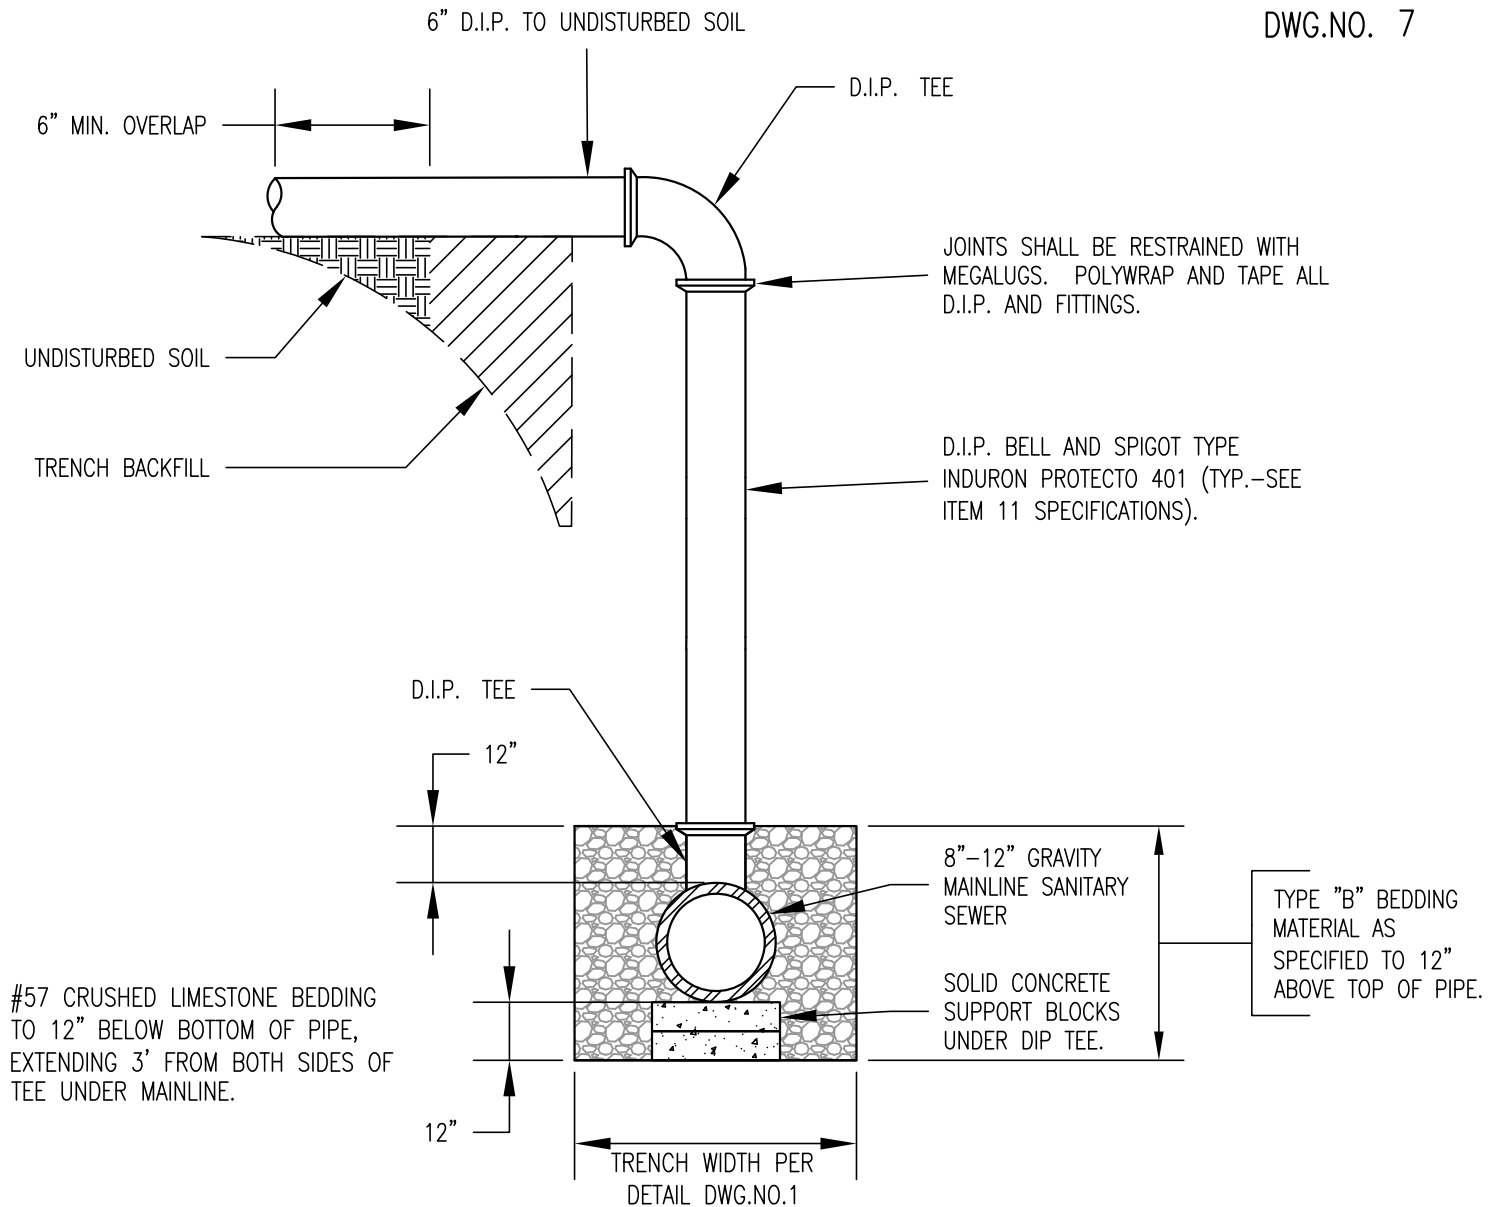

NOTES:

- 1) 6" D.I.P. TO UNDISTURBED SOIL WITH MINIMUM 6" OVERLAP PAYMENT FOR THIS PIECE OF D.I.P. WILL BE MADE UNDER SERVICE SEWER ITEM 14C AS APPLICABLE.
- 2) STACKS SHALL BE INSTALLED WHERE SHOWN ON PLANS OR AS REQUIRED BY ENGINEER.
- 3) STACKS SHALL BE INSTALLED VERTICALLY.
- 4) WHERE SERVICE SEWER ENTERS MAINLINE FROM 0'-44' NO DUCTILE IRON PIPE AND FITTINGS ARE REQUIRED.
- 5) ALL DUCTILE IRON PIPE SHALL BE CLASS 52. JOINT SHALL BE RESTRAINED WITH EBAA IRON MEGALUG, OR APPROVED EQUAL.
- 6) SUITABLE ADAPTERS BETWEEN D.I.P. TEE AND MAINLINE SEWER SHALL BE USED.

NO SCALE

APPROVED 09/21

REVISION	DATE	BY

STARK COUNTY SANITARY ENGINEERING DEPT.	
DETAIL DWG.NO.	7
ITEM NO.	-
<u>SERVICE STACK</u> <u>8"-12" MAINLINE</u>	