


6"Ø C-900 PVC TO UNDISTURBED
SOIL (NO JOINTS IN PIPE)

DWG.NO. 7B

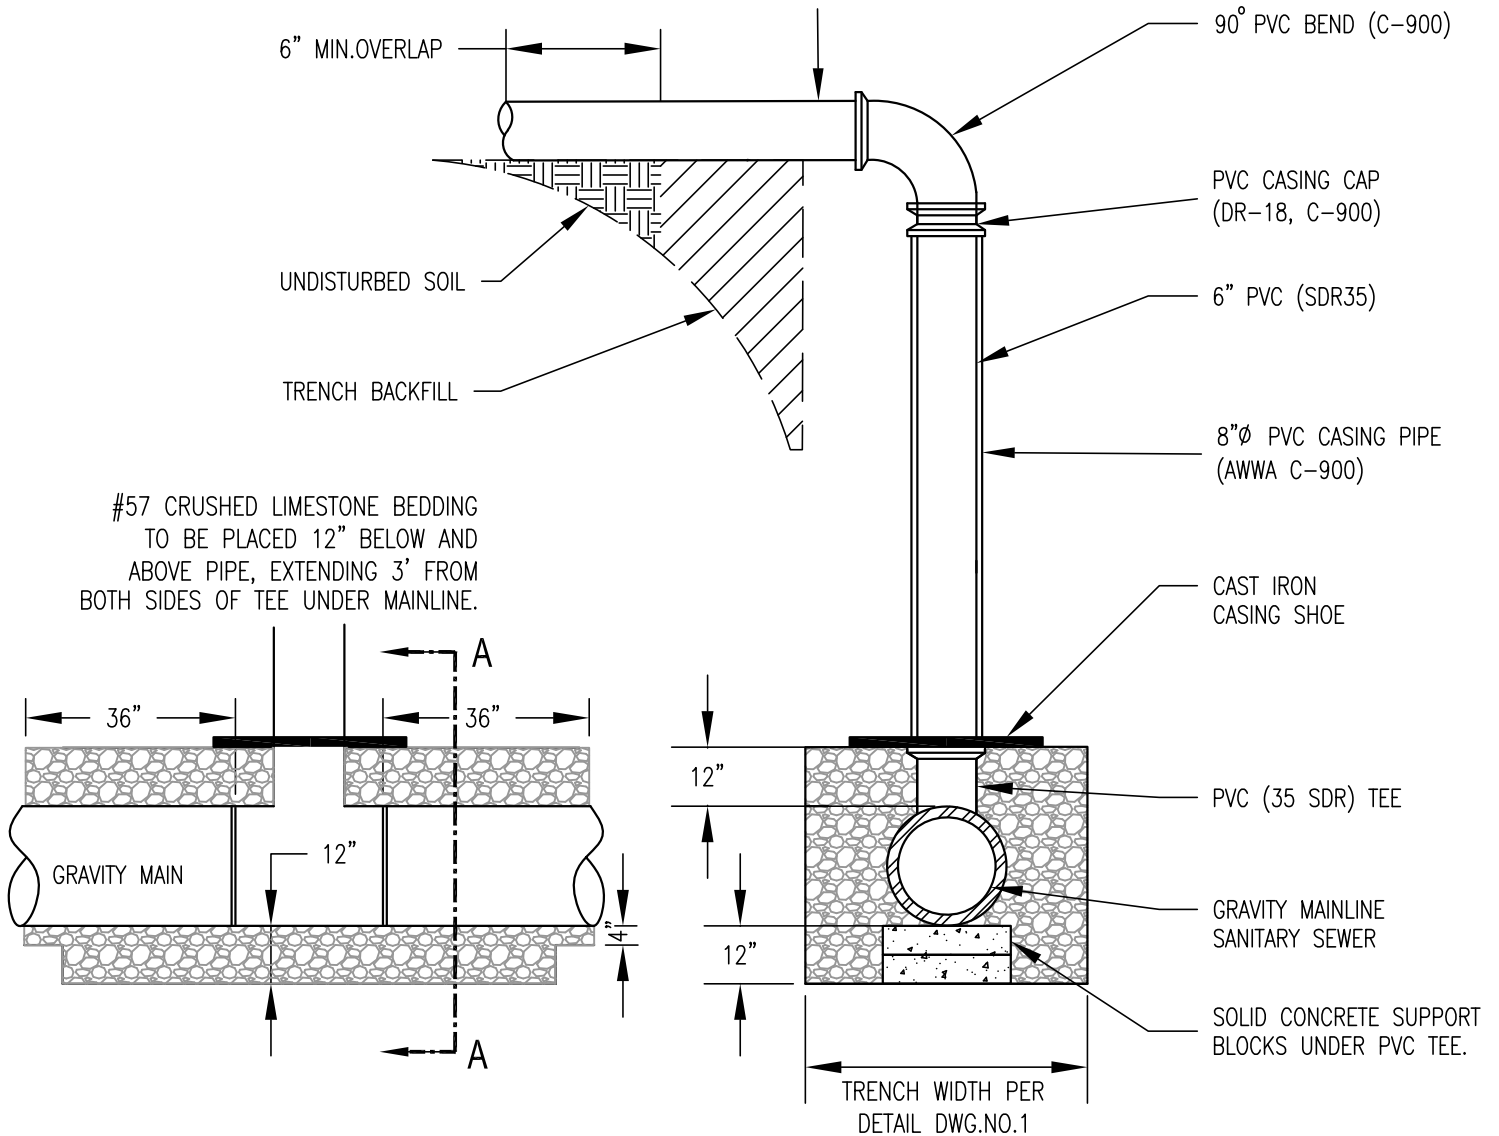

SECTION A - A

NOTES:

- 1) 6"Ø C-900 PVC TO UNDISTURBED SOIL WITH MINIMUM 6" OVERLAP. PAYMENT WILL BE MADE UNDER SERVICE SEWER ITEM 14A, 14B, OR 14C AS APPLICABLE.
- 2) STACKS SHALL BE INSTALLED WHERE SHOWN ON PLANS OR AS REQUIRED BY ENGINEER.
- 3) STACKS SHALL BE A HARCO RISER AS MANUFACTURED BY THE HARRINGTON CORPORATION, OR APPROVED EQUAL.
- 4) WHERE SERVICE SEWER ENTERS MAINLINE FROM 44° - 90° SERVICE STACK PIPING AND FITTINGS ARE REQUIRED.

NO SCALE

APR'D 03/22

STARK COUNTY
SANITARY ENGINEERING DEPT.

REVISION	DATE	BY

DETAIL DWG.NO. 7B
ITEM NO. -

PVC SERVICE STACK
8"-12" MAINLINE