


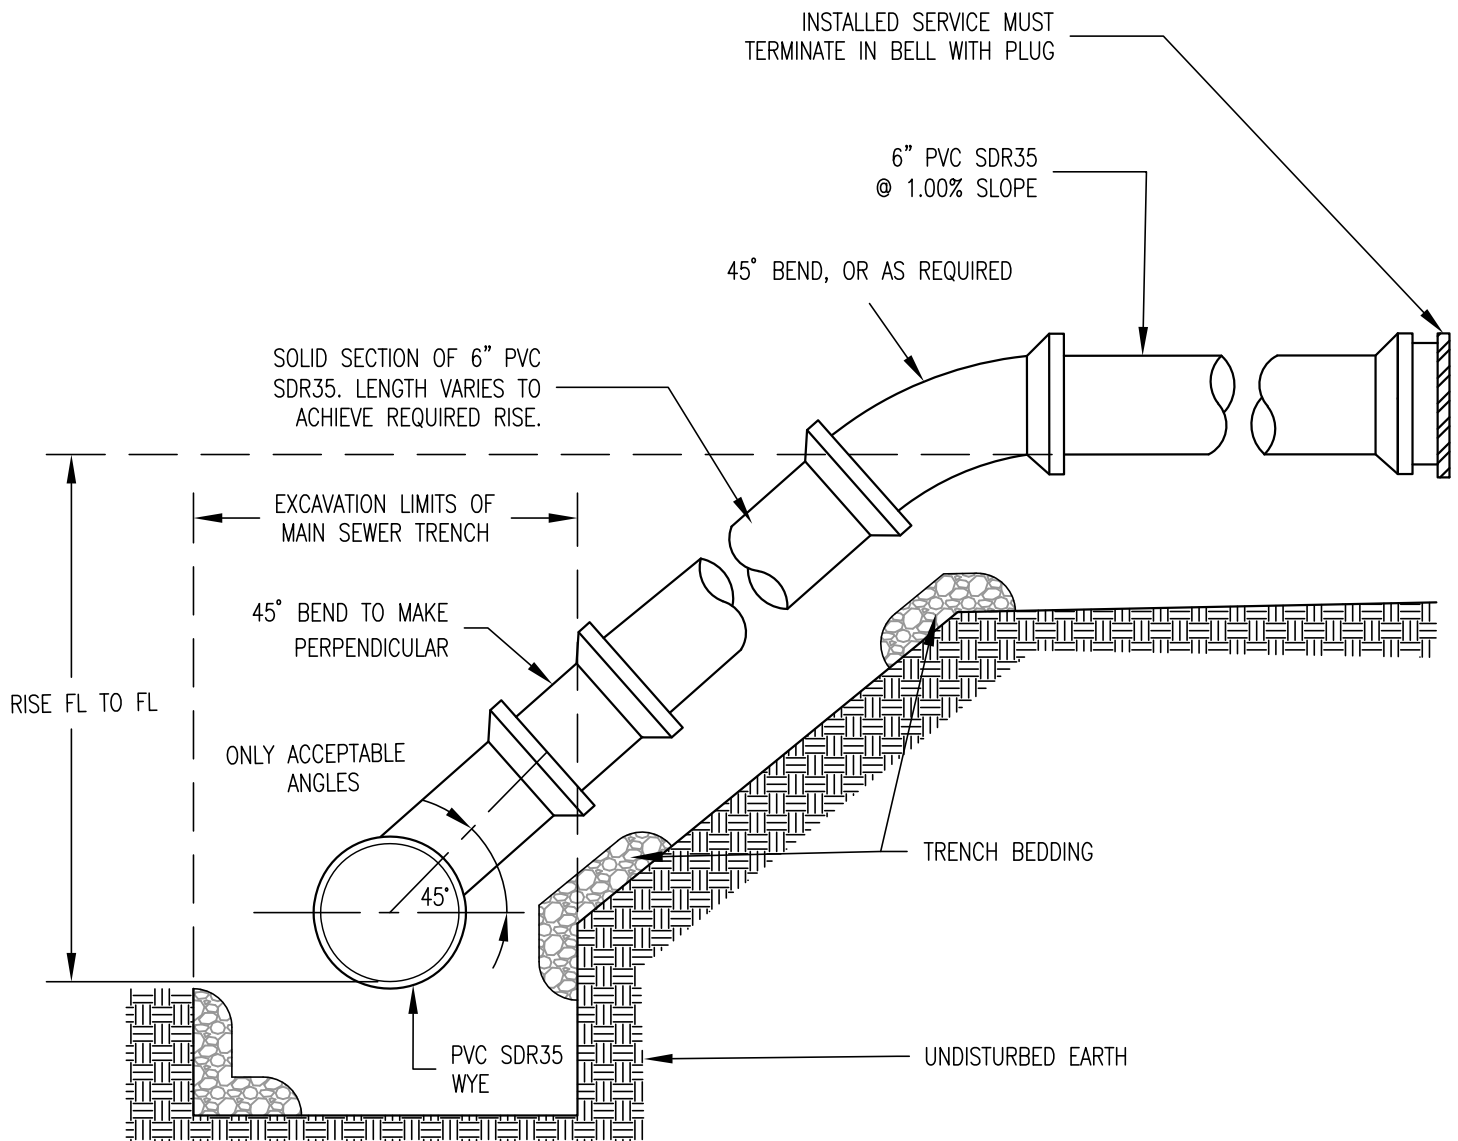

NOTES:

- 1) SEE DWG 1 OR DWG 2 FOR BEDDING & TRENCH REQUIREMENTS.
- 2) IN DEEP LOCATIONS, THE COUNTY MAY REQUIRE AN ALTERNATIVE PVC PIPE CLASSIFICATION.

APPROVED 01/23

REVISION	DATE	BY

NO SCALE

STARK COUNTY
SANITARY ENGINEERING DEPT.

DETAIL DWG.NO. 7C

ITEM NO. -

SLOPED SERVICE
CONNECTION