


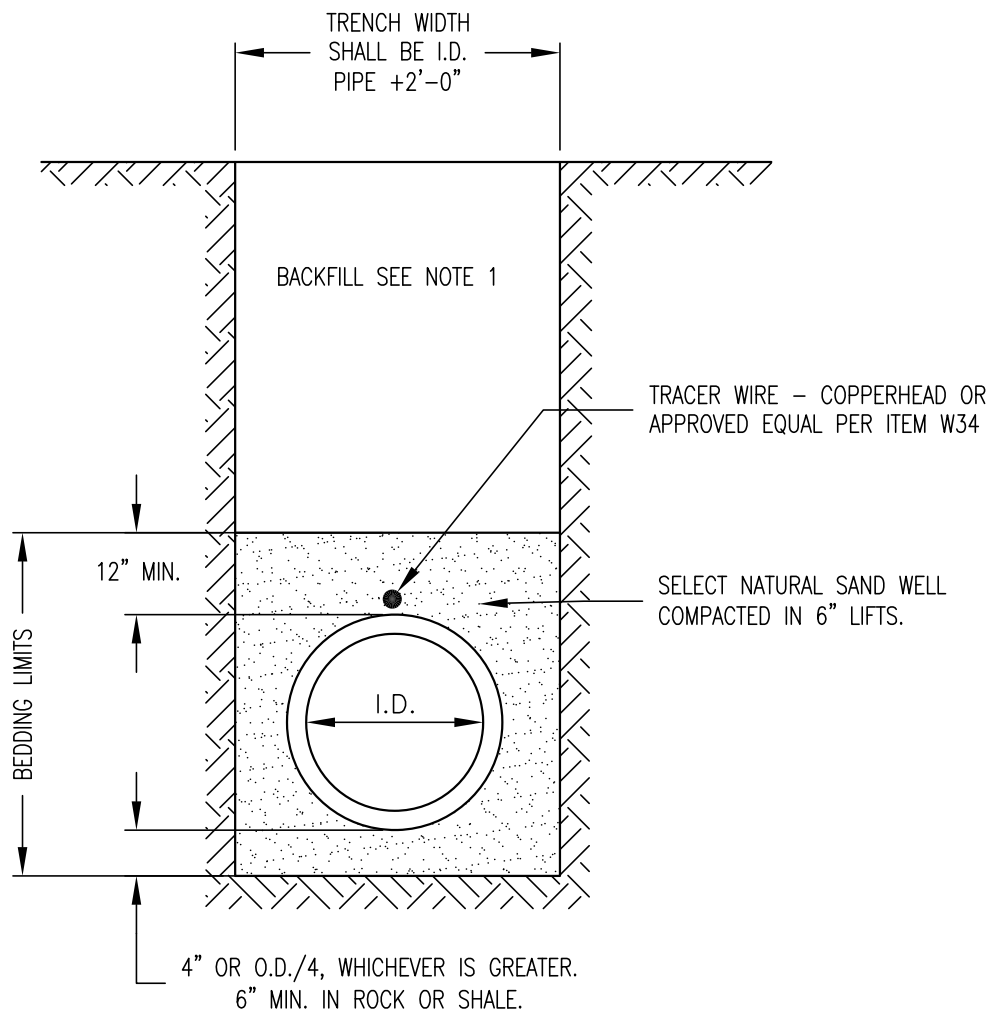

NOTES:

1. IN AREAS OUTSIDE OF PAVEMENT, SELECT ON-SITE MATERIAL MAY BE USED IN LIFTS NOT TO EXCEED 6" FOR BACKFILL ABOVE BEDDING.
2. ALL WATERLINE BEDDING SHALL BE SELECT NATURAL SAND UNLESS OTHERWISE NOTED ON THE PLANS OR AUTHORIZED BY THE ENGINEER.
3. SLAG BEDDING SHALL NOT BE USED.

APR'D 08/23

REVISION	DATE	BY

NO SCALE

STARK COUNTY
SANITARY ENGINEERING DEPT.

DETAIL DWG.NO. 28

ITEM NO. -

WATERLINE TRENCH DETAIL