
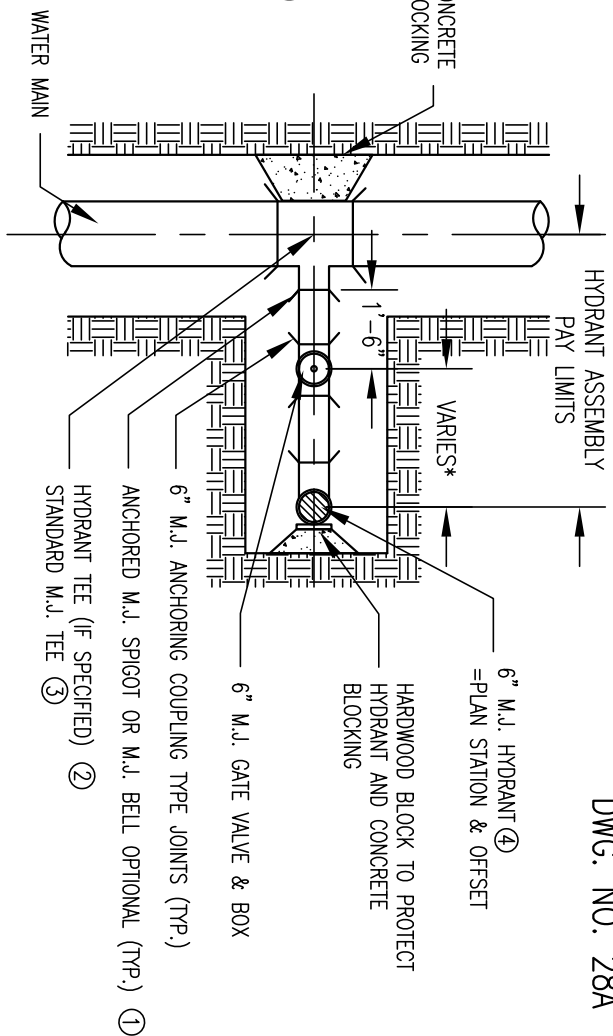


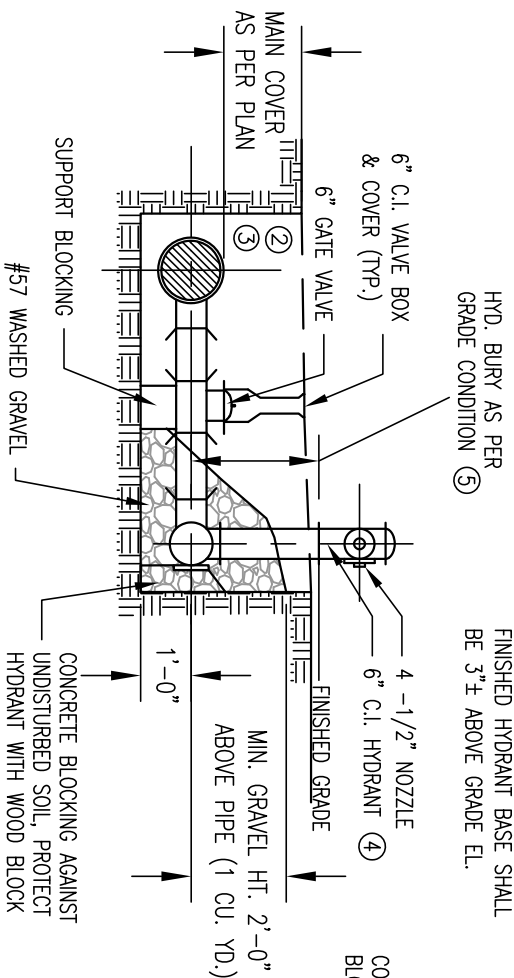

SECTION

TYPE "A" PLAN

1. ANCHORED M.J. SPIGOT OR M.J. BELL - OPTIONAL AS REQUIRED FOR LATERAL CLEARANCE.
2. HYDRANT TEE (CLOW NO. F-1224 OR APPROVED EQUAL) ON DUCTILE CAST IRON PIPE FOR MAIN SIZES 6" THRU 12" DIA.
3. STANDARD M.J. TEE WITH 6" BRANCH FOR ALL SIZES OF DUCTILE IRON PIPE.
4. HYDRANT SHALL BE MUELLER SUPER CENTURION 250 3-WAY A-421.
5. IN MOST CASES, STANDARD HYDRANT BURY IS 5'-0". THE CONTRACTOR SHALL SUPPLY AN OFFSET HYDRANT CONNECTOR PIPE FOR ALL INSTALLATIONS, AT NO ADDITIONAL COST, TO BRING THE HYDRANT TO THE PROPER HEIGHT ABOVE FINISHED GRADE.
6. TURN HYDRANT SO 4-1/2" NOZZLE FACES STREET.
7. ALL PIPE SHALL BE RESTRAINED JOINT.

NO SCALE

APR'D 08/23

REVISION	DATE	BY

STARK COUNTY
SANITARY ENGINEERING DEPT.

DETAIL DWG.NO. 28A

ITEM NO. X

TYPICAL HYDRANT
ASSEMBLY, TYPE "A"