


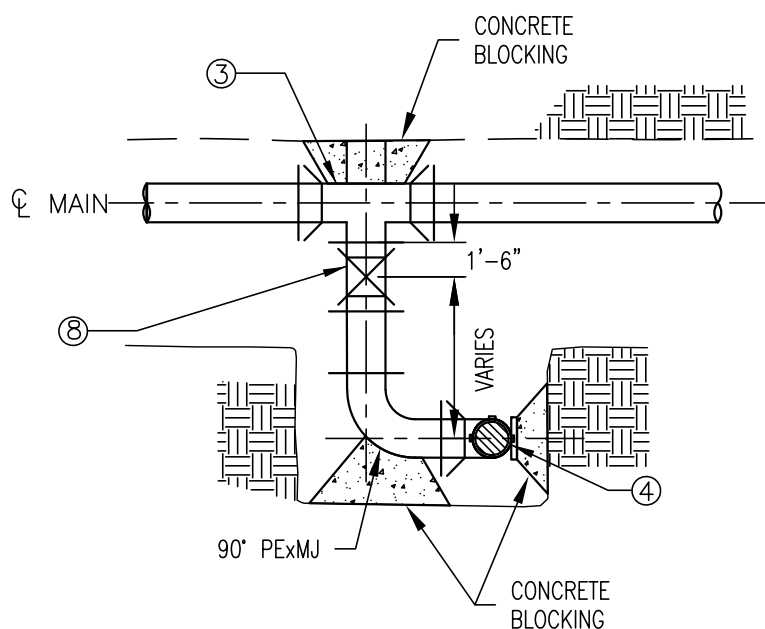

TYPE "B" PLAN

NOTES:

1. ANCHORED M.J. SPIGOT OR M.J. BELL – OPTIONAL AS REQUIRED FOR LATERAL CLEARANCE.
2. HYDRANT TEE (CLOW NO. F-1224 OR APPROVED EQUAL) ON DUCTILE IRON PIPE FOR MAIN SIZES 6" THRU 12" DIA. (IF SPECIFIED).
3. STANDARD M.J. TEE WITH 6" BRANCH FOR ALL SIZES OF DUCTILE IRON PIPE.
4. HYDRANT TO BE MUELLER SUPER CENTURION 250 3-WAY A-421.
5. IN MOST CASES, STANDARD HYDRANT BURY IS 5'-0". THE CONTRACTOR SHALL SUPPLY AN OFFSET HYDRANT CONNECTOR PIPE FOR ALL INSTALLATIONS, AT NO ADDITIONAL COST, TO BRING THE HYDRANT TO THE PROPER HEIGHT ABOVE FINISHED GRADE.
6. TURN HYDRANT SO 4-1/2" NOZZLE FACES STREET.
7. ALL PIPE SHALL BE RESTRAINED JOINT.
8. WATCH VALVE AND BOX TO BE SUPPORTED SO AS NOT TO CAUSE DAMAGE TO ANY OF THE OPERATING MECHANISM.

NO SCALE

APR'D 08/23

REVISION	DATE	BY

STARK COUNTY
SANITARY ENGINEERING DEPT.

DETAIL DWG.NO. 28B

ITEM NO. W37

TYPICAL HYDRANT ASSEMBLY
SCSE TYPE "B"